


Smart-PAK PLUS Analog Expansion Board Wiring Diagram

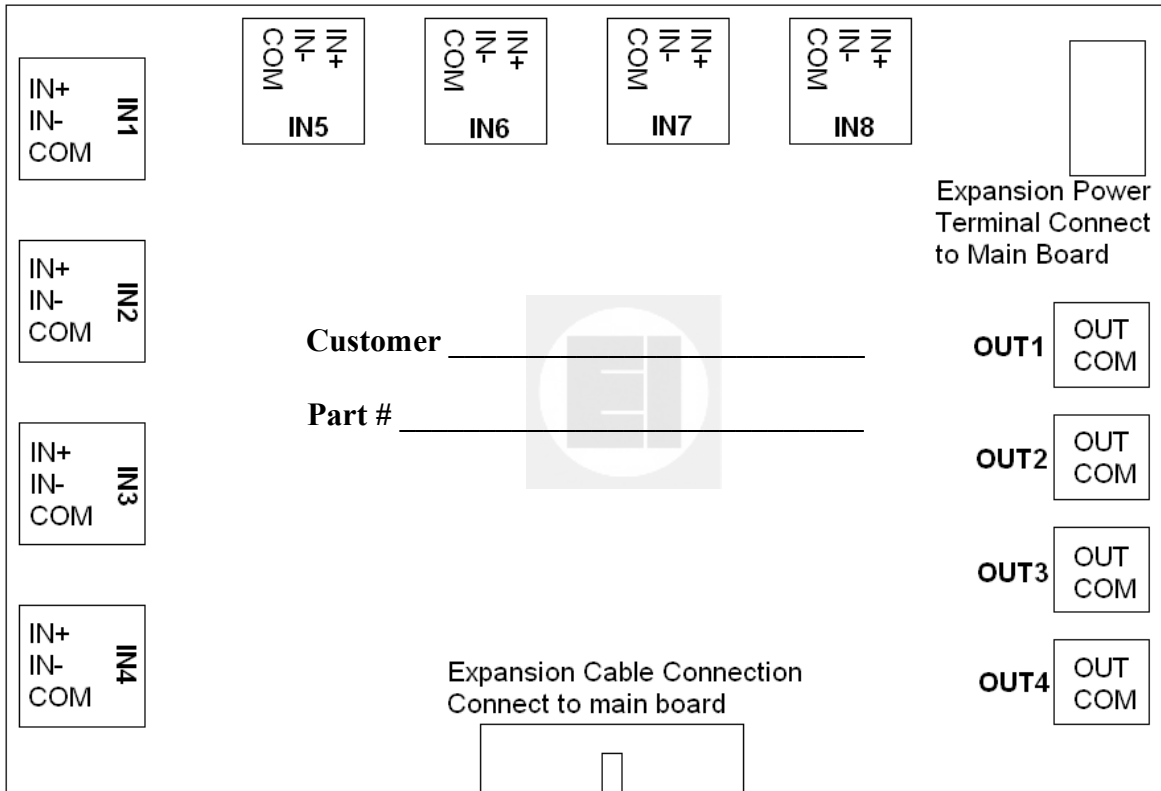

Current Inputs	Connect current to IN+ and IN- terminals, Voltage on IN+ and IN- terminals not to exceed 10 volts relative to com terminal.
Voltage Inputs	Connect inputs source to IN+ and IN- terminals, IN+ and IN- not to exceed 10 volts relative to com terminal.
RTD Inputs	Inputs 5-8 only, Three wire : Connect black wires to IN+ and com terminals, Connect red wire to IN- terminal. *Isolated RTD's Only*
Thermocouple	Inputs 1-4 only, (Type K thermocouples only). When using thermocouples, all other analog channels become +/- type inputs. *Isolated Thermocouples Only*

Input #1 =	Output #1 =
Input #2 =	Output #2 =
Input #3 =	Output #3 =
Input #4 =	Output #4 =
Input #5 =	Special Notes:
Input #6 =	
Input #7 =	
Input #8 =	

Dimensions	W = 6.50" , H = 4.50"
-------------------	-----------------------



ENTERTRON INDUSTRIES INC.
Specializing in PLCs for OEMs since 1978

3857 Orangeport Rd, Gasport NY 14067
 Phone (716)772-7216 Web www.entertron.com E-Mail plcs@entertron.com